


# SETTLEABLE SOLIDS ARRESTOR PANELTIM - Below-Ground - W.A.

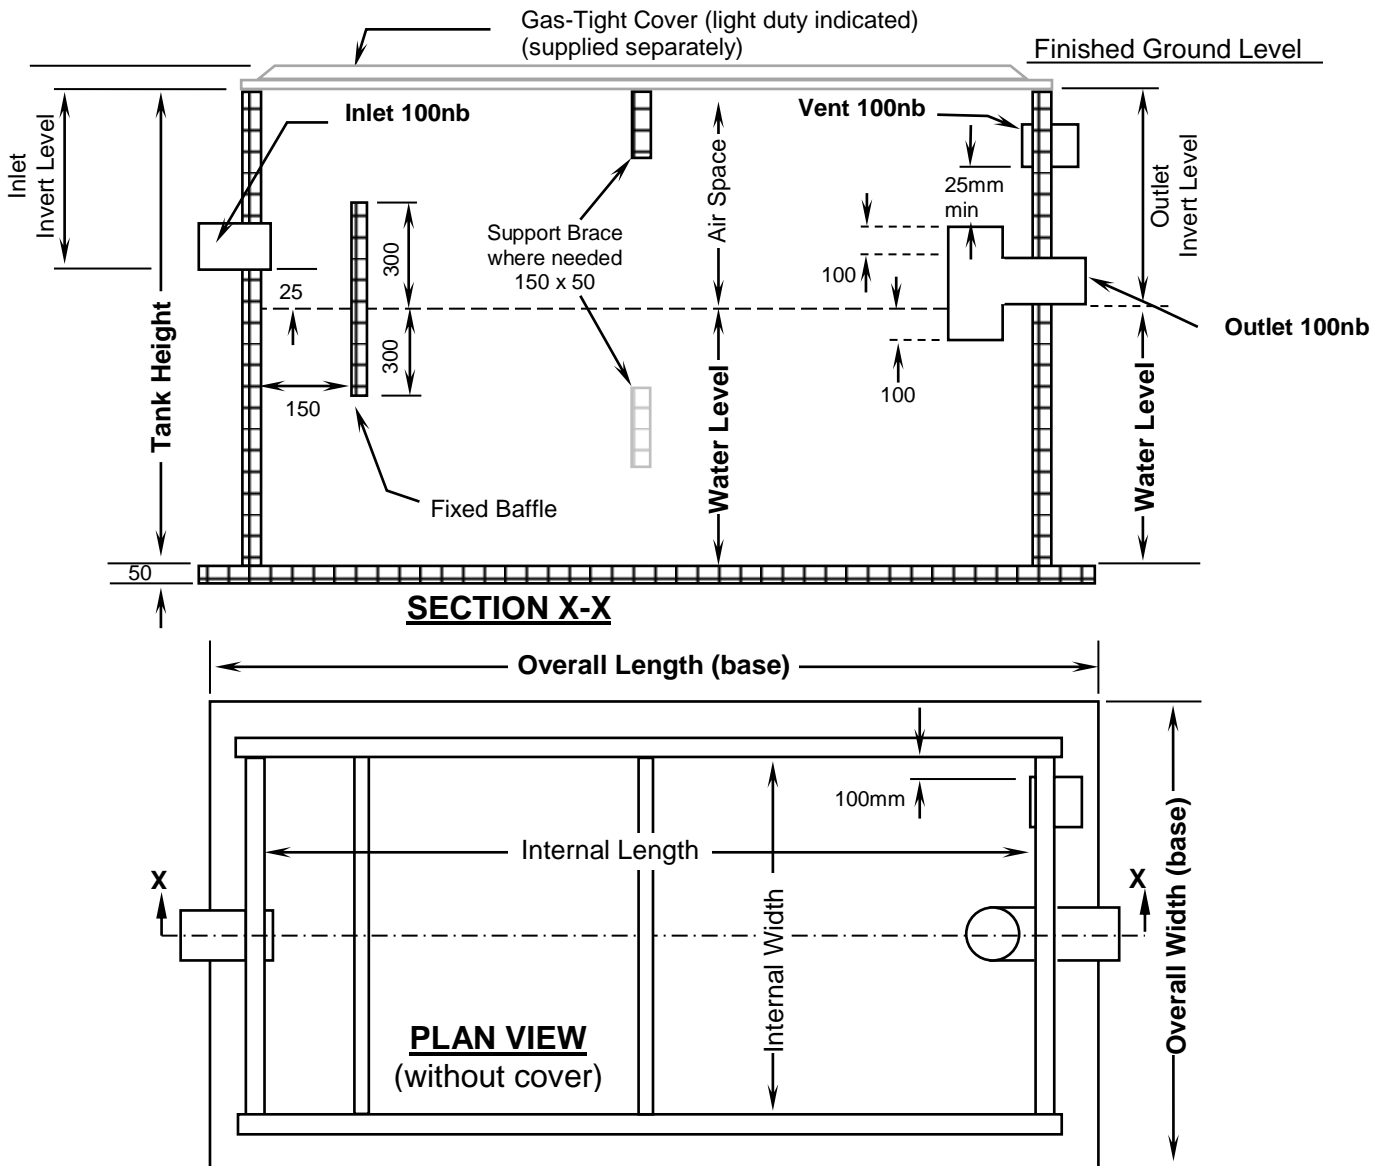

**NOTES:**

- The entire tank, including baffles, is constructed of Paneltim construction panel. Pipe nozzles are Polypropylene or HDPE
- Installation and burial procedures must be conducted in accordance with the Viking Paneltim Tank Installation Guidelines For Below-Ground Installations. *This document is available by request or can be downloaded from the Viking Plastics website.*
- Paneltim Tanks are designed and engineered to be installed without the need for concrete back-fill (see previous note).
- Tanks must be installed according to Water Corp installation guidelines.
- The relevant authority must approve the proposed location of a trade waste interceptor prior to its installation.
- A program for regular maintenance and cleaning should be established with an authorised waste collection contractor.
- The tank design conforms to approved design drawings as issued by Water Corporation WA. We recommend the appropriateness of the tank design and its proposed location be verified for use by the local Water Authority prior to order placement.

**Larger sizes and custom made tanks are available on request**

Model (Nov 2016)	Capacity (litres)	Internal Dimensions				Overall Dimensions (base)			Inlet Invert Level	Outlet Invert Level	Air Space
		Length	Width	Water	Height	Length	Width	Height			
<b>SSABG-1000</b>	1000	1400	750	960	1260	1800	1000	1310	275	300	300
<b>SSABG-1250</b>	1250	1400	750	1200	1500	1800	1000	1550	275	300	300
<b>SSABG-1500</b>	1500	1900	750	1100	1400	2400	1000	1450	275	300	300
<b>SSABG-2000</b>	2000	2400	750	1120	1420	2800	1000	1470	275	300	300

For further information, contact...

**Viking Plastics Engineering Pty Ltd**  
143 Woodlands Drive, Braeside Vic 3195

**Ph 03 9587 2297**

E [info@vikingplastics.com.au](mailto:info@vikingplastics.com.au)

**Fx 03 9587 1172**